




GROUND FLOOR
1 : 100

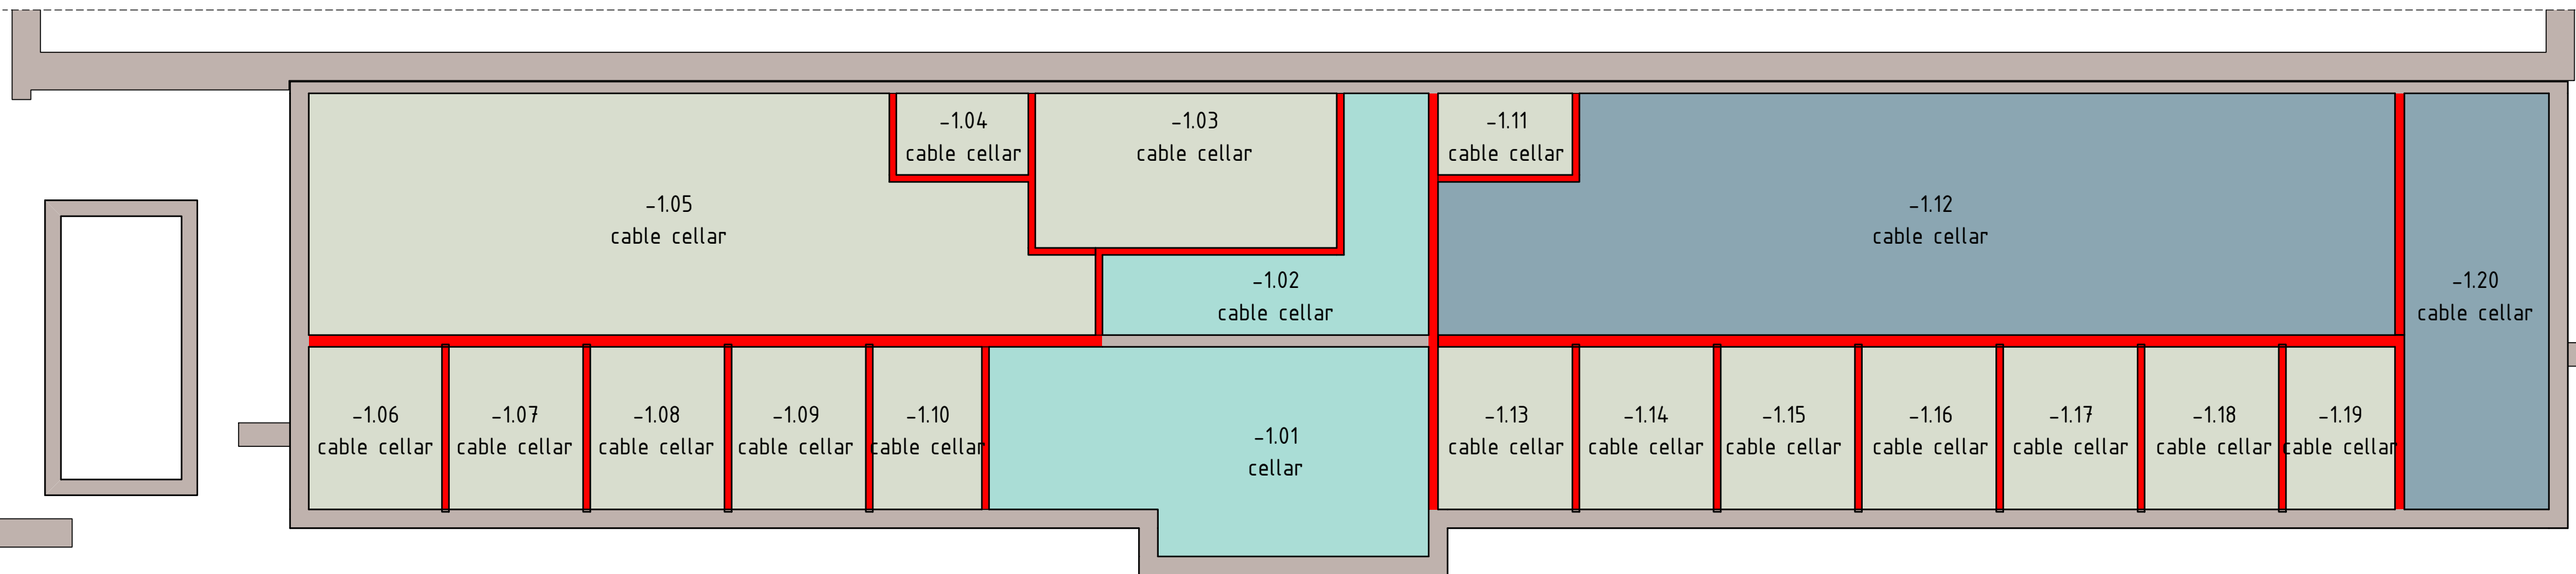

CABLE CELLAR (-1200 P)
1 : 100

Fire safety

- double-sided fireproof, 30 of 60 minutes
- self-closing
- wdbdo 30 minutes
- wdbdo 60 minutes
- eye wash
- CO2 fire extinguisher
- foam fire extinguisher
- escape route marking

All fire compartments, wdbdo 60 min.

- fire compartment 1
- fire compartment 2
- fire compartment 3
- fire compartment 4
- all small E-rooms wdbdo 60 min.

Peil = 24mtr + NAP

0m 1m 2m 3m 4m 5m

Worley energy chemicals resources				Worley Number: NR1038/C.01/0048 Client Number: 1333.105			
B	2021-05-31	For Building Permit			5.1		
A	2021-04-01	Draft			5.1		
Rev	Issue Date	Revision Description	Prepared by	Checked by	Disc Appr by	Proj Appr by	
fact. no.	fact. dpt	processgr./-unit	itemcode/tag no.	project no.	size	higher reference doc. no.	part no
title: PUMP BUILDING							
Fire safety, ground floor							
fact./fact. dept: Nobian Industrial Chemicals B.V.							
project: Brine Field Haaksbergen							
scale	dimensions in	Am. proj.	separate partlist	doc. type	abbr.	location doc. no.	
1:100	mm			12	DAR		
Nobian Nobian Industrial Chemicals B.V.				size	doc. no.	sh.	
© Nobian PO Box 25, 7550GC, Mergel, The Netherlands				A1	1.333.105		